

MODEL CODE

NUMBER OF ROOM SENSOR KITS

1 = 1 Room Sensor Kit
2 = 2 Room Sensor Kits
3 = 3 Room Sensor Kits
4 = 4 Room Sensor Kits

SENSOR RANGE

1 = -0.1" TO +0.1" wc
2 = -0.2" TO +0.2" wc
3 = -0.4" TO +0.4" wc

DISPLAY TYPE

1 = 7" Touch Screen

ISO


OPTIONS

BLANK = No Options
M = BACnet MS/TP
W = Wireless Bluetooth

DISPLAY CABLE LENGTH

1 = 25' (7.6m)
2 = 50' (15.2m)
3 = 75' (22.9m)
4 = 100' (30.5m)

SYSTEM DIAGRAM

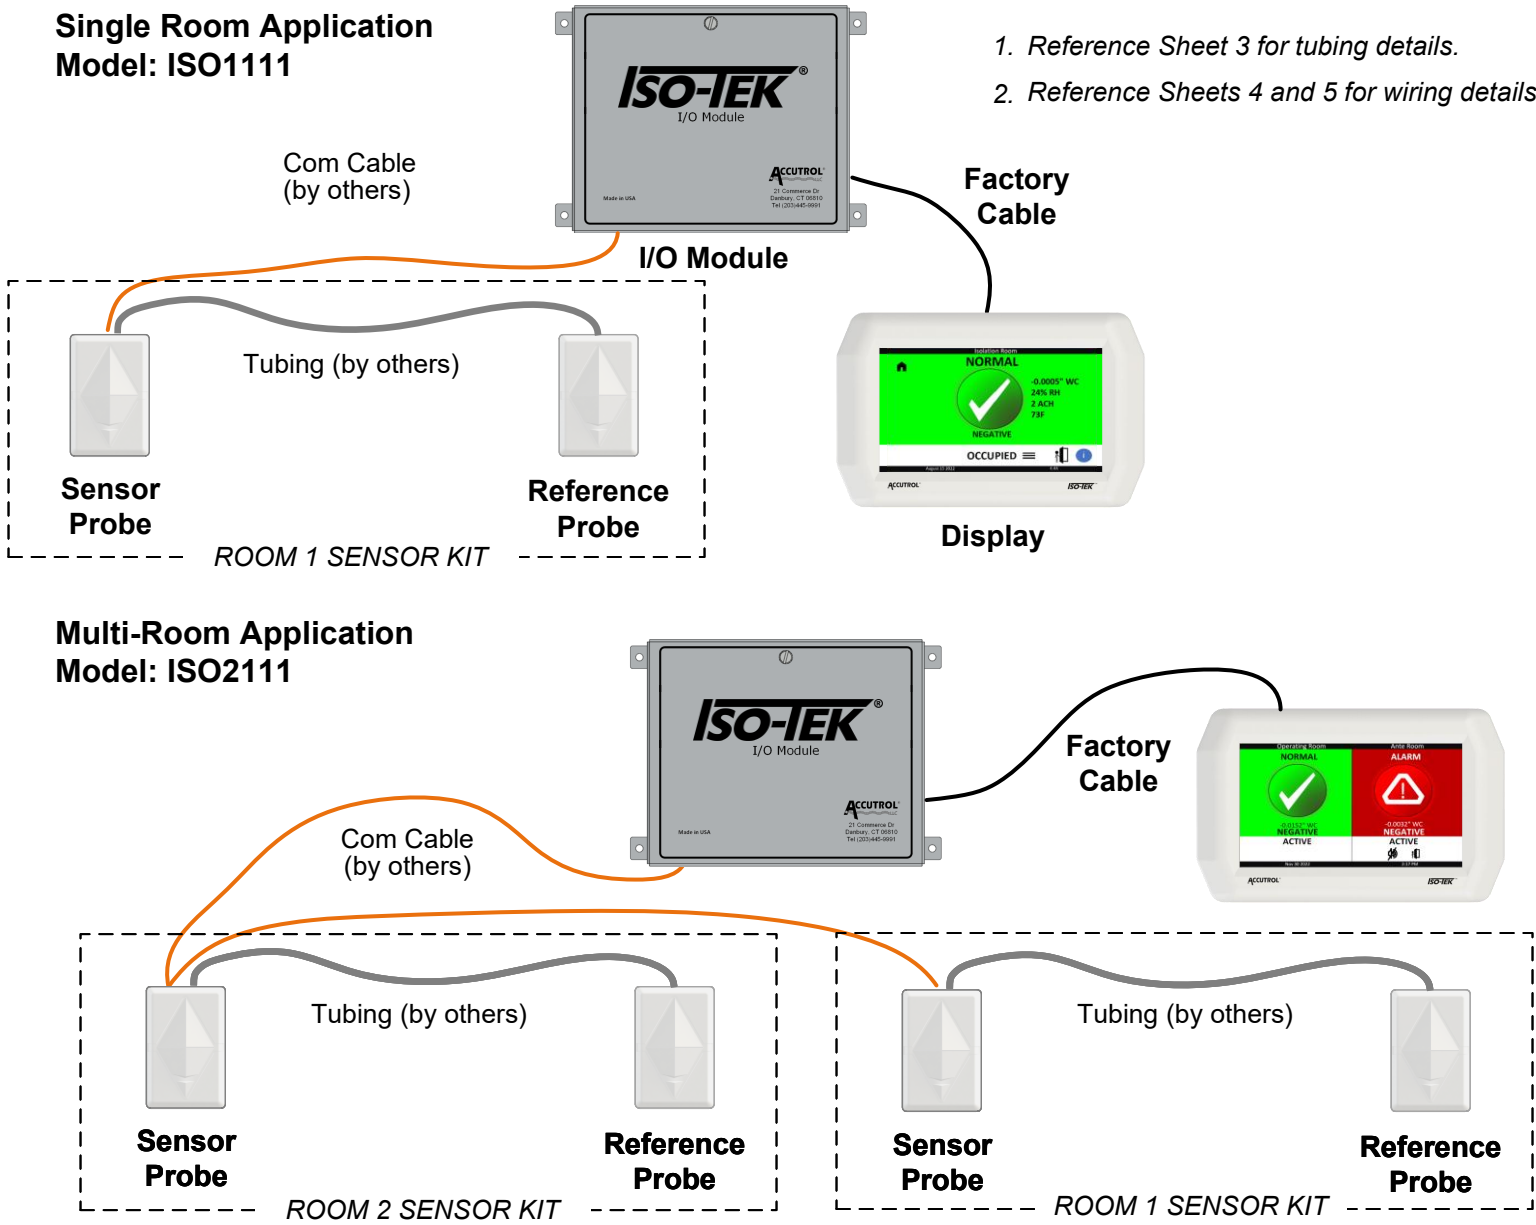

- NOTES:
- 1. Reference Sheet 3 for tubing details.
 - 2. Reference Sheets 4 and 5 for wiring details.

SPECIFICATIONS

PRESSURE SENSOR			
Full Scale Pressure Range	± 0.100"wc (25Pa)	± 0.200"wc (50Pa)	± 0.400"wc (100Pa)
Pressure Measurement Resolution	0.00000335"wc (0.00083Pa)	0.00000670"wc (0.00166Pa)	0.00001338"wc (0.00333Pa)
Zero Offset	Typical: ± 0.00016"wc (0.04Pa)		
	Maximum: ± 0.0004"wc (0.1Pa)		
Span Accuracy	Typical: ± 0.75% of reading		
	Maximum: ± 1.5% of reading		
Static Error Band	± 3% of reading Note: Includes linearity, hysteresis, & repeatability		
Long Term Stability	± 0.00008"wc (± 0.02Pa) per year max		
Thermal Effects			
Offset	Max: ± 0.0004"wc (±0.1pa)	Max: ± 0.0008"wc (±0.2pa)	Max: ± 0.0008"wc (±0.2pa)
Span - of reading per 18°F (10 °C)	Typ: ±0.2% Max: ±0.5%	Typ: ±0.2% Max: ±0.5%	Typ: ±0.2% Max: ±0.5%
Status Indicator	Green LED to indicate status		
Connection	4-Pos. Screw Terminal (Note: connect to I/O Module using Windy City Wire # 042003 or equivalent)		
Operating Temperature	-4 to 176 °F (-20 to 80 °C)		
Storage Temperature	-40 to 185 °F (-40 to 85 °C)		
Humidity	0 to 95% RH non-condensing		
Display (Local HMI)			
Display Type	7" LCD-TFT Resistive touch display with LED backlight		
Color	RGB 65K colors		
Active Area	6.49" x 3.937" (164.9mm x 100mm)		
Resolution	800 x 480 pixel		
Speaker	audible notifications, 550~18KHz, 83dBA SPL @ 1W/0.5M		
Connections	RJ-45 connector (Note: connect to IO Module using factory-provided cable only)		
Configuration Port	USB 2.0, Isolated, Type C Conn., connect PC with Iso-Tek Insight		
Operating Temperature Range	-4 to 150 °F (-20 to 65 °C)		
Storage Temperature Range	-40 to 185 °F (-40 to 85 °C)		
Humidity	10 to 90% noncondensing		
I/O Module			
System Input Power	24VAC +/-20%, 22VA, 50-60Hz (Class 2 Power Source) or 24 VDC +/- 10%, 10W		
Configuration Port	USB 2.0, Isolated, Type C Conn, connect PC with Iso-Tek Insight.		
Relay Outputs	2 Independent SPST Relay Contacts (Software Configurable)		
	Contact Rating; 2A @ 30VDC, 0.5A @ 60VDC, 0.3A @ 125VAC		
Analog Outputs	2 Analog Outputs for Room Pressure (Software Configurable)		
	0-5v, 1-5v, 0-10v, 2-10v, 0-20mA or 4-20mA		
	capable of driving 1 K-ohm load		
Door Switch Input	Dry Contact Input for Primary Room Door Switch (software configurable)		
Accutrol Sensor Port	5-pos. pluggable screw terminal		
	Note: connect to Pressure Sensor Network using Windy City Wire # 042003 only		
Accutrol Display Port	RJ-45 connector		
	Note: Connect to Display Module using factory-provided cable only		
BACnet MS/TP (Optional)	EIA 485 2-wire, BACnet MS/TP, Galvanically Isolated		
	1/8 unit load transceiver impedance		
	Full Master Node State Machine		
	Data Rates 9600, 19200, 38400, 76800 and 115200		
	MAC address is software configurable		
BACnet IP (Optional)	Future		
Status Indicators	LED Indicators for Power, Pressure Sensor, Display, BACnet, & Bluetooth		
I/O Terminal Blocks	Removable Vertical Plugs, Wire Size Range 12-30 AWG		
Bluetooth (Optional)	Bluetooth Version 4.2 or later, connect to PC with Iso-Tek Insight		
Operating Temp Range	-20 to 176 deg F (-29 to 80 deg C)		
Storage Temp Range	-40 to 185 deg F (-40 to 85 deg C)		
Humidity	0 to 95% noncondensing		
COMPLIANCE			
	RoHS, UL94-V0, CE		

ACCUTROL LLC

21 Commerce Dr
Danbury, CT 06810
Tel: 203-445-9991
accutrolllc.com

Accutrol Representative:

SUBMITTAL DRAWING



Iso-Tek®

THIS DOCUMENT IS SUBJECT TO CHANGE WITHOUT NOTICE.
THIS DOCUMENT OR THE CONTENTS THEREOF SHALL NOT BE MODIFIED WITHOUT PRIOR WRITTEN PERMISSION BY ACCUTROL LLC.


DWG. NO:	Iso-Tek SUBMITTAL			
REVISION:	L	ECN:	3184	
REV. DATE:	6-10-26	SHEET:	1 OF 5	

DIMENSIONS


Display Module

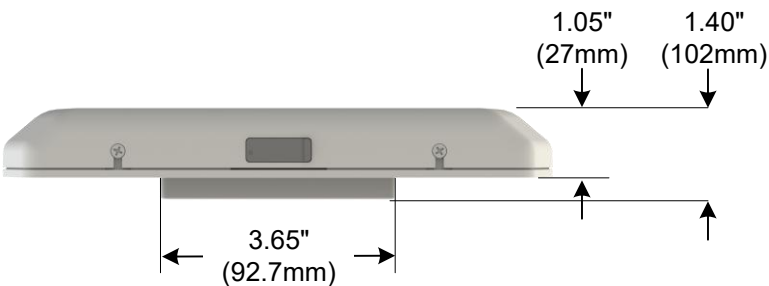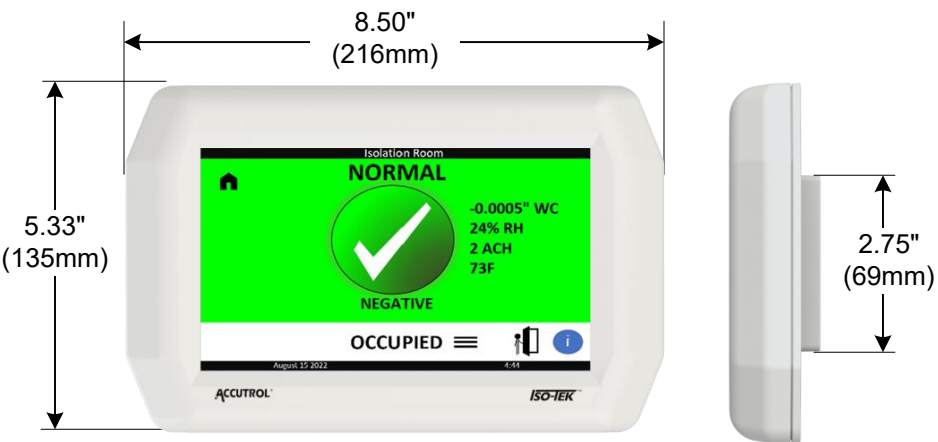


Display Cable

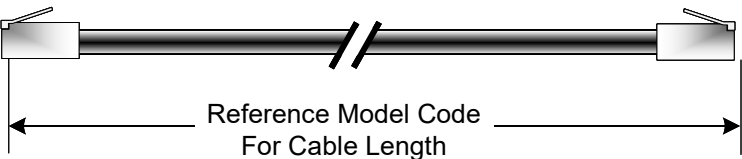


I/O Module

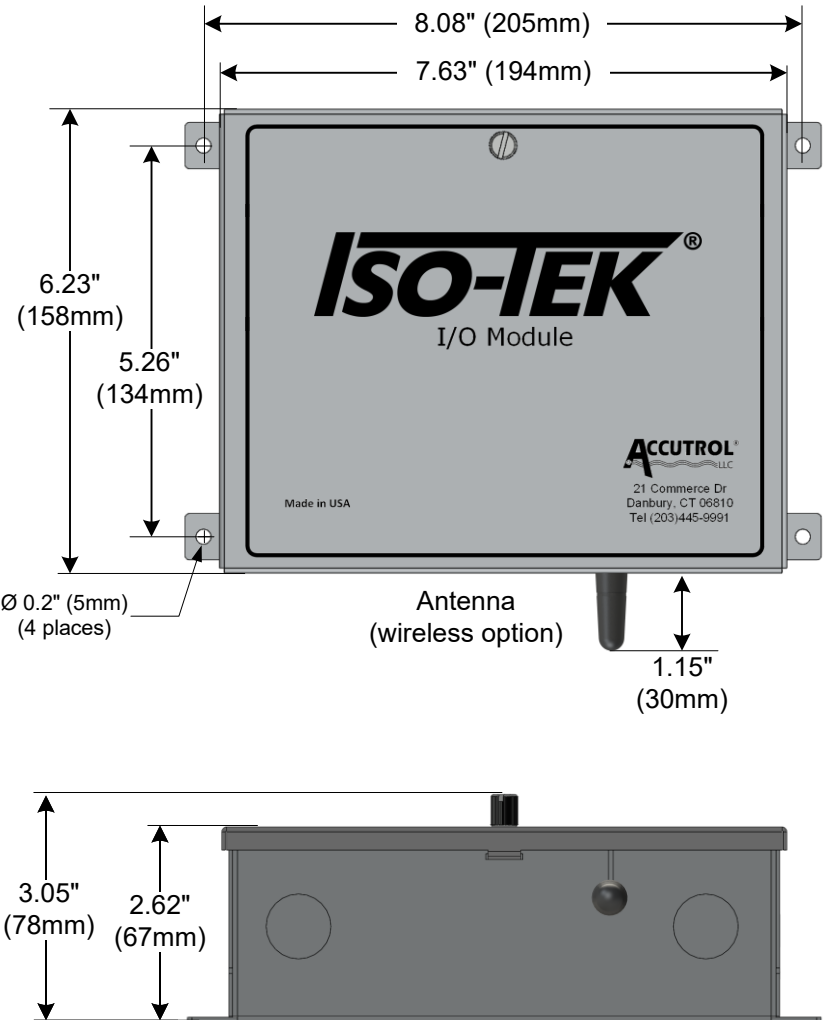

Sensor Probe

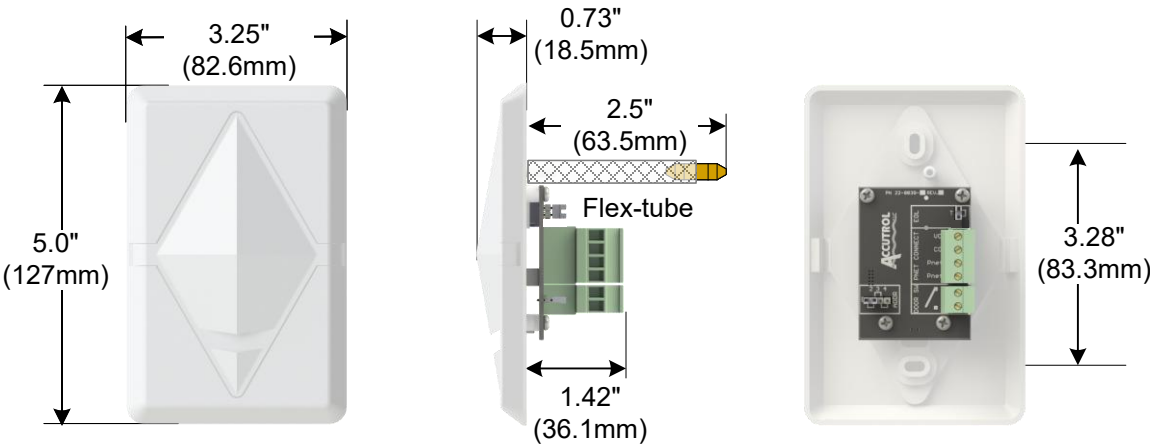

Reference Probe

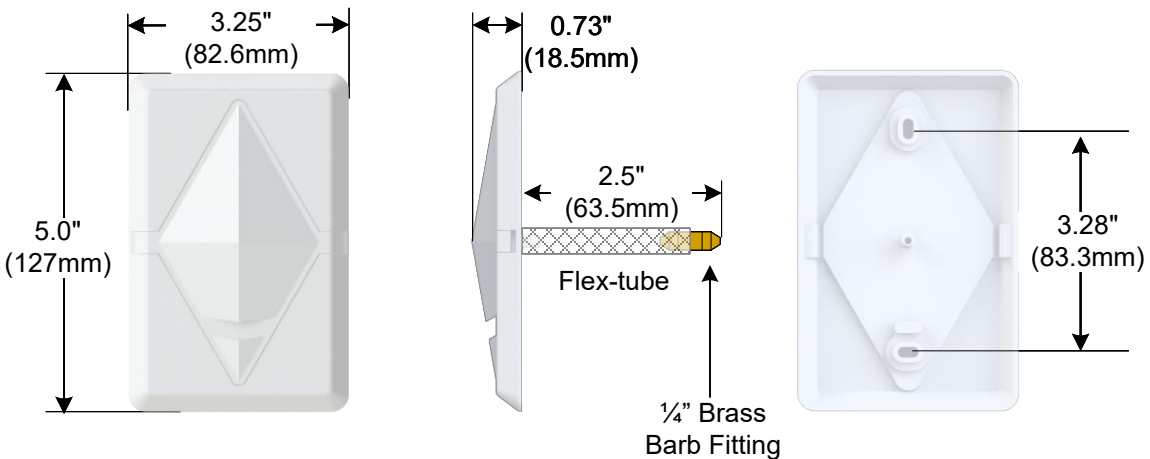

Materials

All Materials are RoHS Compliant
I/O Module Enclosure: 16 Gauge Aluminum Alloy 5052-H32
Display Module Bezel & Mounting Plate: ABS Plastic UL94-V0
Sensor Probe and Reference Probe: ABS Plastic UL94-V0
Display Cable: Plenum-rated shielded cable



Accutrol Representative:

SUBMITTAL DRAWING

Iso-Tek®


THIS DOCUMENT IS SUBJECT TO CHANGE WITHOUT NOTICE. THIS DOCUMENT OR THE CONTENTS THEREOF SHALL NOT BE MODIFIED WITHOUT PRIOR WRITTEN PERMISSION BY ACCUTROL LLC.	DWG. NO:	Iso-Tek SUBMITTAL		
	REVISION:	L	ECN:	3184
	REV. DATE:	6-10-26	SHEET:	2 OF 5

INSTALLATION

Display Module

The Display Module is designed to be installed onto a standard double or triple-gang electrical box (e-box) provided by others. The e-box is typically located at eye-level at the entrance of the room being monitored.

- Step 1: Install the e-box level & flush with finished wall surface.
- Step 2: Insert Display Cable from e-box through the hole located in the Display Mounting Plate.
- Step 3: Position the Display Mounting Plate with the arrow UP and secure to e-box using the (4) #6-32 x 1" long screws provided.
CAUTION: Do not overtighten mounting screws. Overtightening may deform mounting plate .
- Step 4: Align the notches in the top of Display with slots in the top of the Mounting Plate.
- Step 5: Tighten the (2) screws located at the bottom of the Display to secure the Bezel to the Backplate.

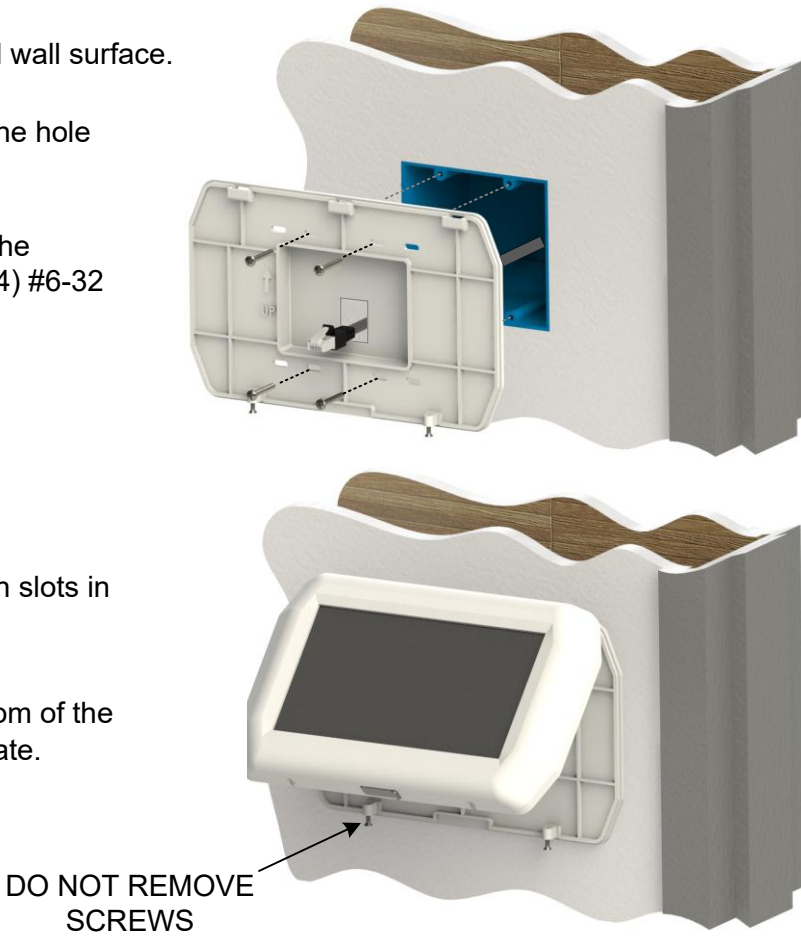

I/O Module

The I/O Module enclosure includes 4 flanges with 0.2" dia holes provided for securing the I/O Module to a wall or panel plate. The I/O Module is typically located in the vicinity of the room above the ceiling or inside a control panel that is within the range of the display cable provided.

Secure I/O Module to mounting surface using either (4) #8 or #10 screws (Provided by others).


For sheetrock installation, use the appropriate wall anchors (provided by others).




Sensor Probe & Reference Probe

The Sensor and Reference Probes are designed to be installed onto a single-gang electrical box (e-box). The sensor probe shall be located inside of the pressurized space and the reference probe shall be installed outside the pressurized space in a location designated as the reference pressure zone for the room being monitored. Both probes shall be located in areas that will not be influenced by air currents from supply diffusers, fans, personnel, etc..

- Step 1: Install the e-box level & flush with finished wall surface.
- Step 2: Run field tubing (by others) from Sensor Probe e-box to Reference Probe e-box.
- Step 3: Each probe is provided with a short length of kink-proof tubing with a 1/4" barb fitting. Connect the field tubing to the barb fitting on the Sensor Probe and Reference Probe.

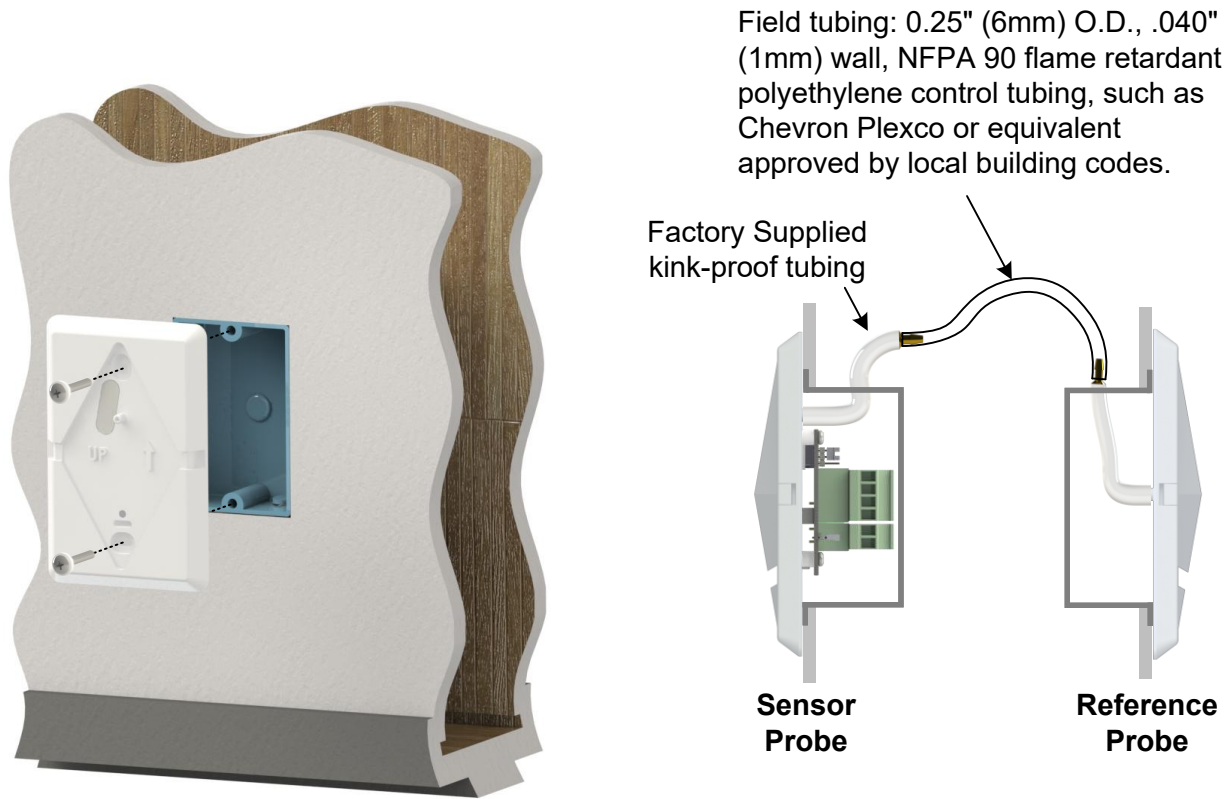


- Step 4: Remove airflow deflector plates on both probes to reveal mounting holes by pulling outwards on the side tabs.
- Step 5: Position the Probe with the arrow UP and secure to e-box using the (2) #6-32 x 1" long screws with attached gasket provided.
CAUTION: Do not overtighten mounting screws. Overtightening may deform mounting plate .
- Step 6: After installation is complete, reattach the airflow deflector plates.

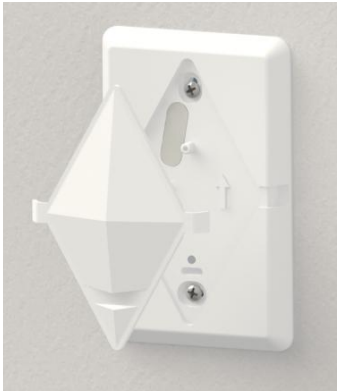



WIRING

CAUTION: Maintain polarity when power source is used to power multiple devices otherwise equipment may be damaged.

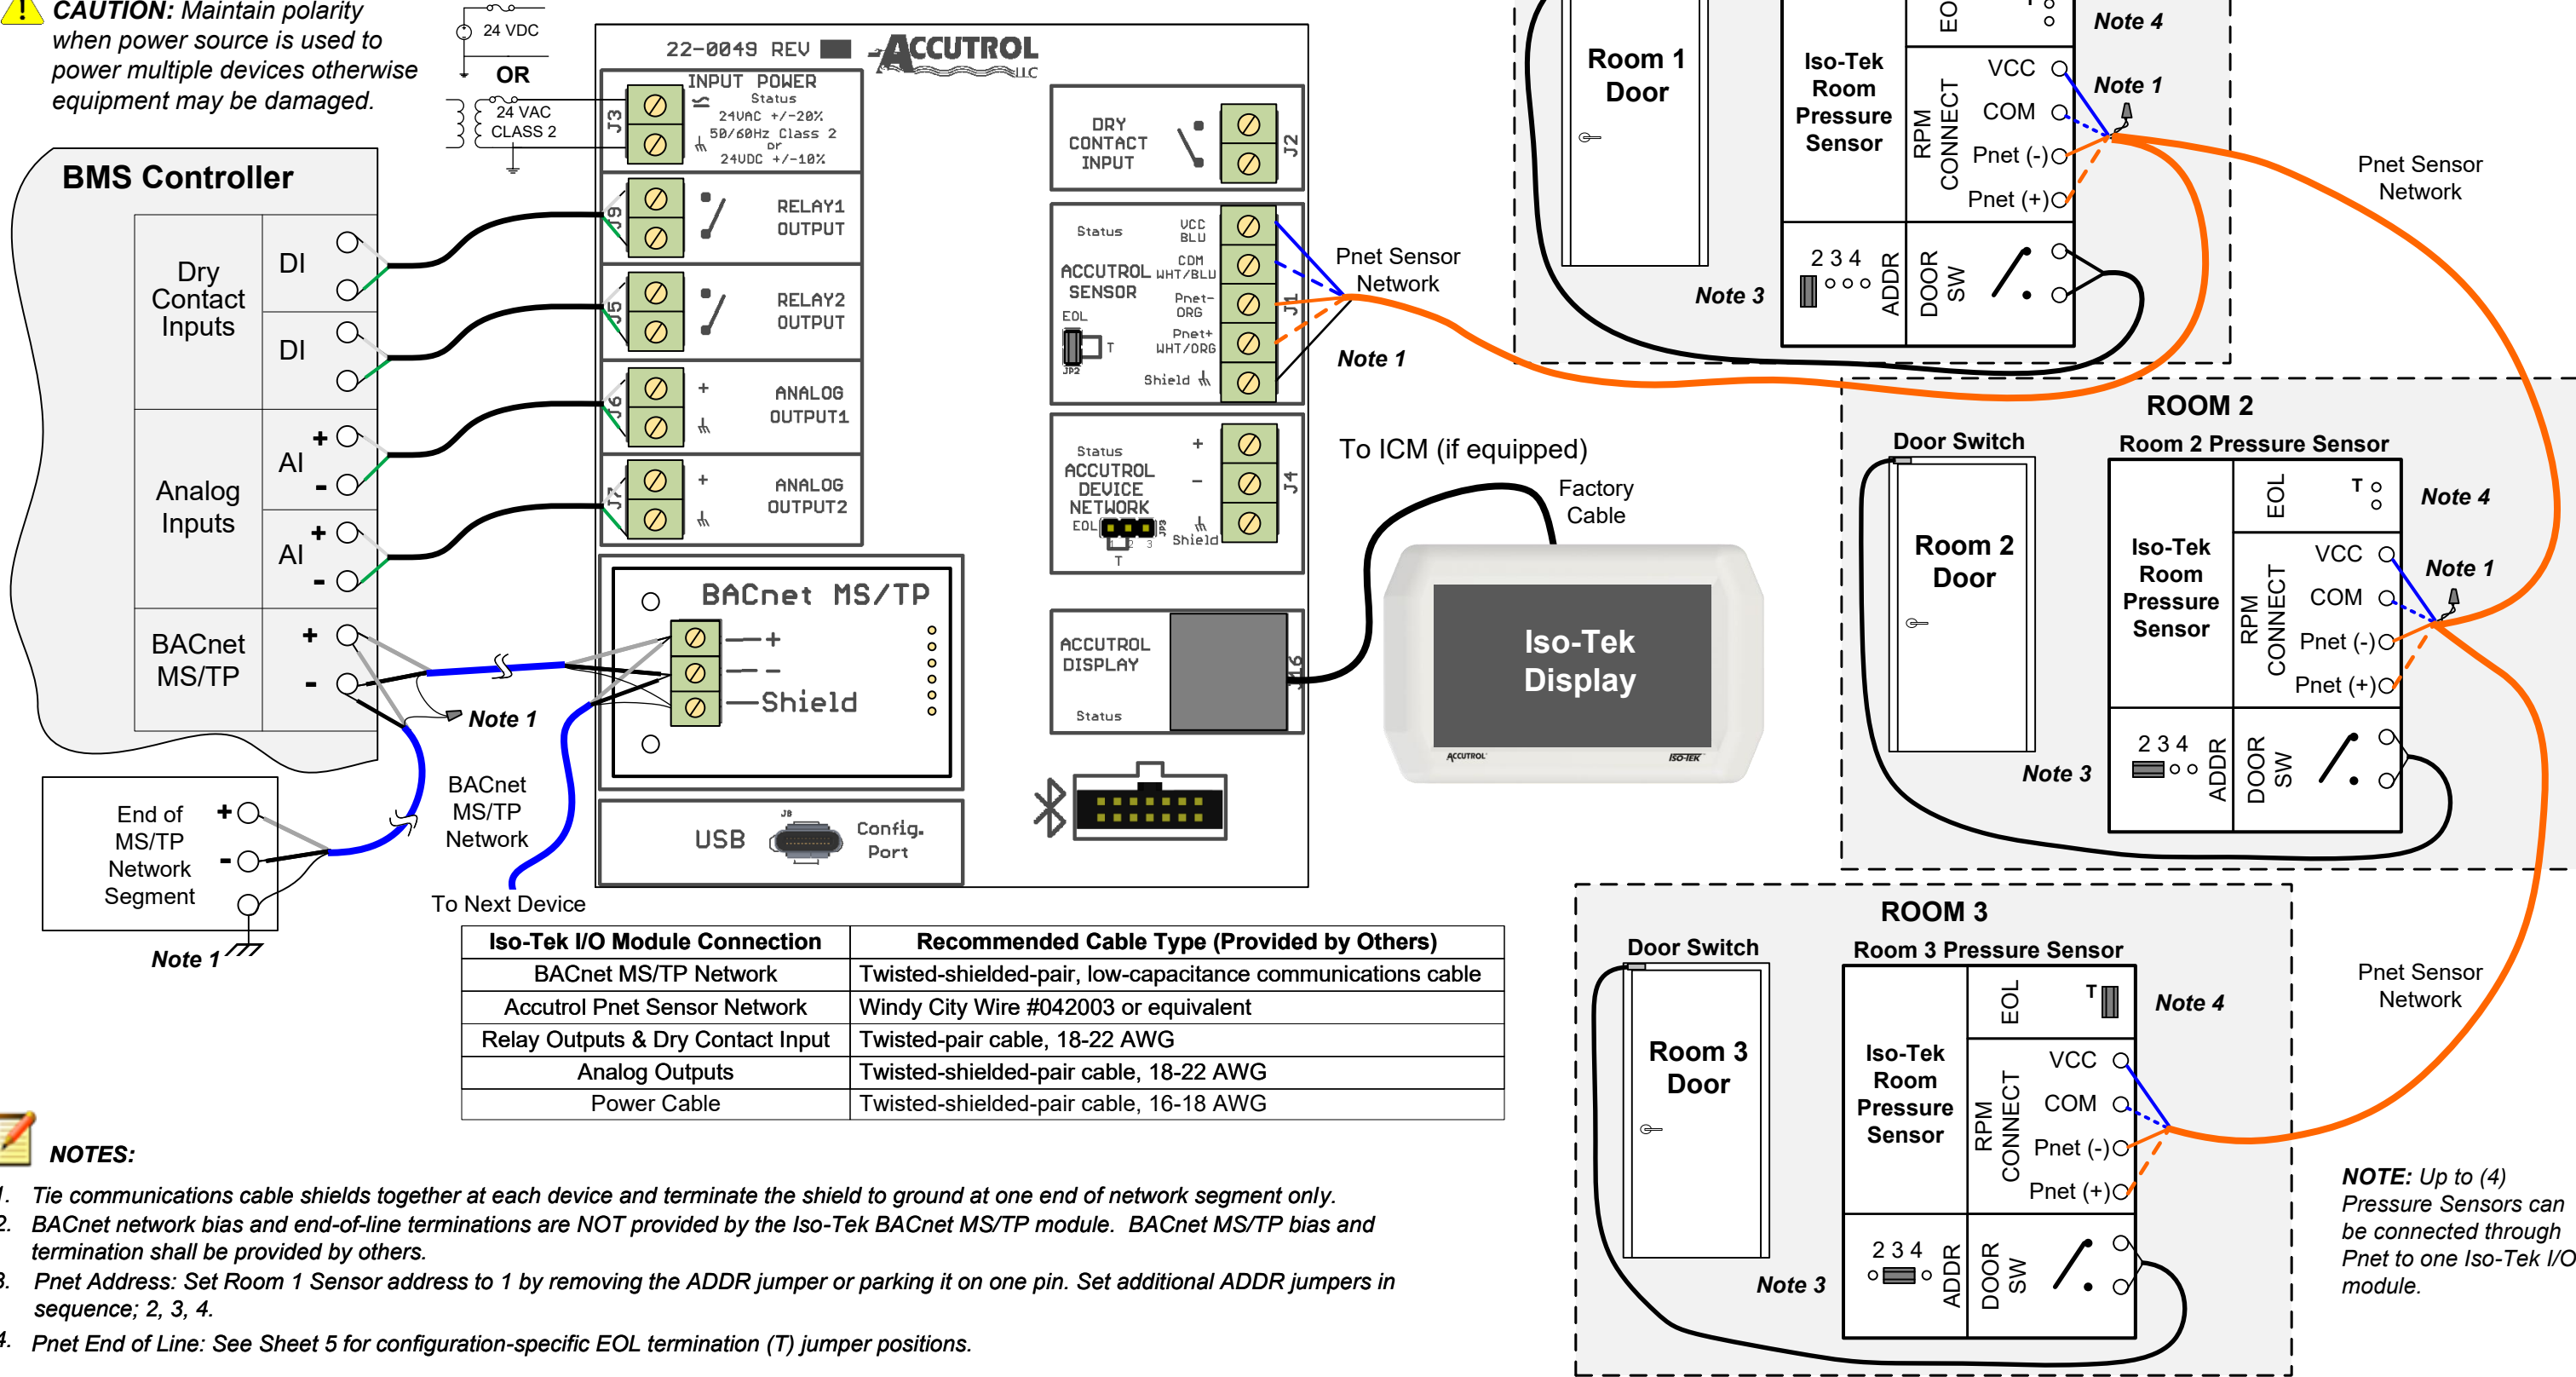


SYSTEM DIAGRAM OPTIONS

ONE ROOM

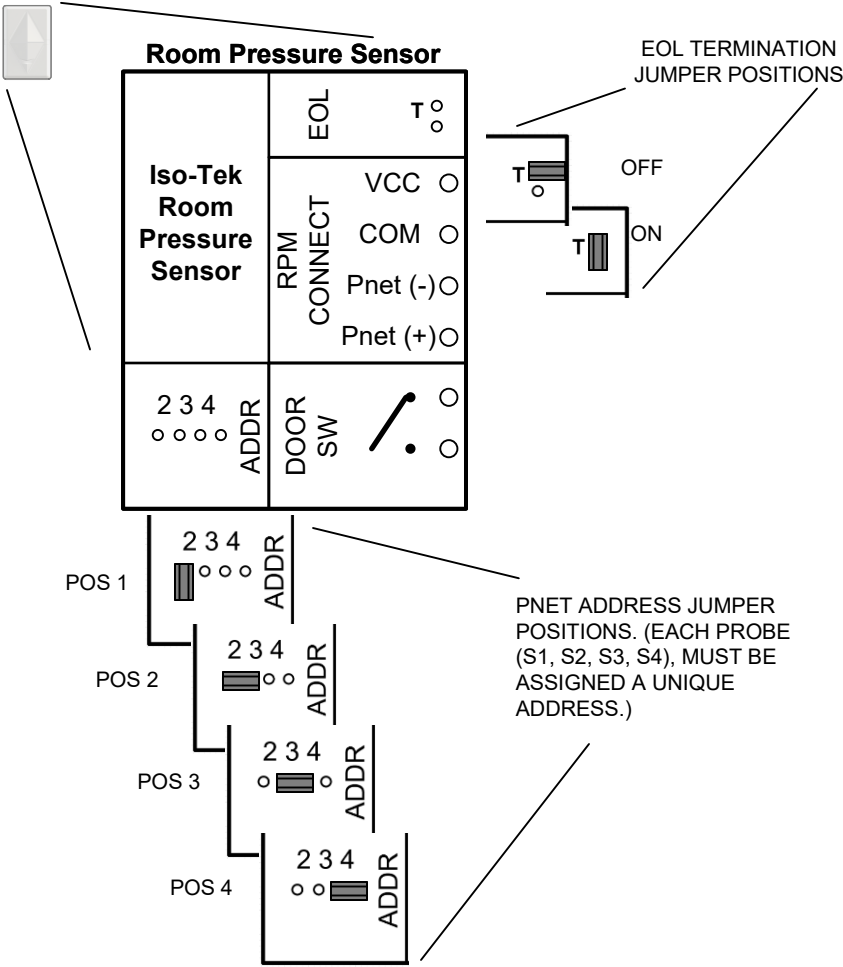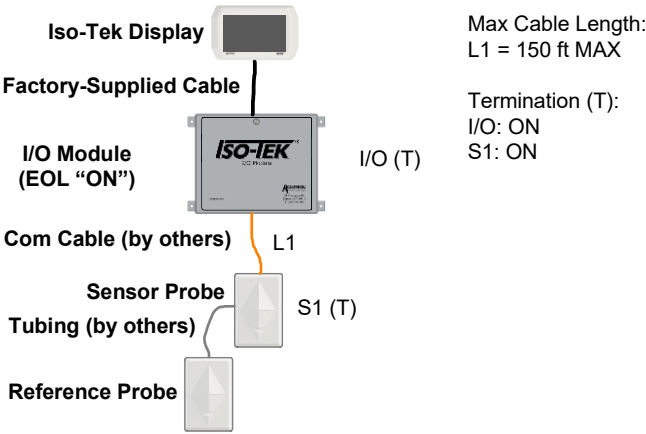


TWO ROOM CONFIGURATION OPTIONS

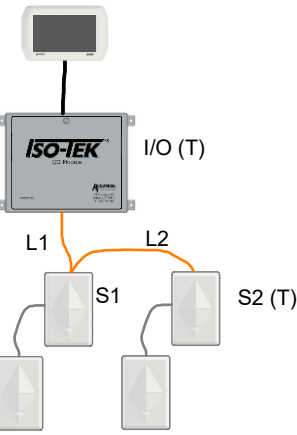

Max Cable Length:
L1 + L2 = 100 ft MAX Total


Termination (T):
I/O: ON
S1: OFF
S2: ON

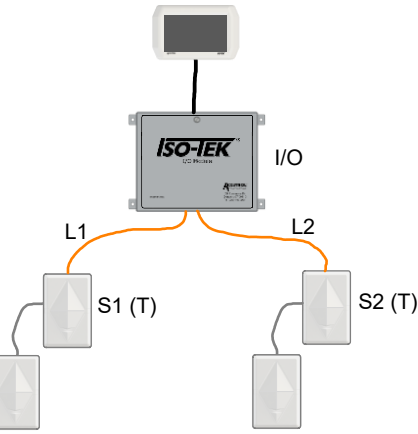

Max Cable Length:
L1 = 150 ft MAX
L2 = 150 ft MAX


Termination (T):
I/O: OFF
S1: ON
S2: ON

THREE ROOM CONFIGURATION OPTIONS

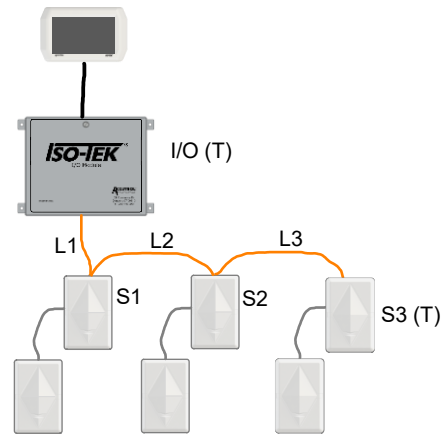

Max Cable Length:
L1 + L2 + L3 = 100 ft MAX Total


Termination (T):
I/O: ON
S1: OFF
S2: OFF
S3: ON

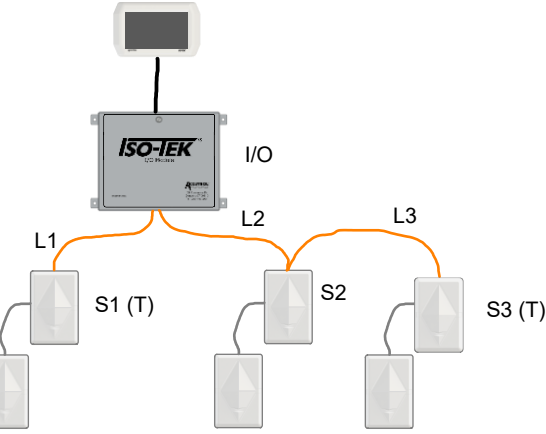

Max Cable Length:
L1 = 150 ft MAX
L2 + L3 = 100 ft MAX Total


Termination (T):
I/O: OFF
S1: ON
S2: OFF
S3: ON

FOUR ROOM CONFIGURATION OPTIONS

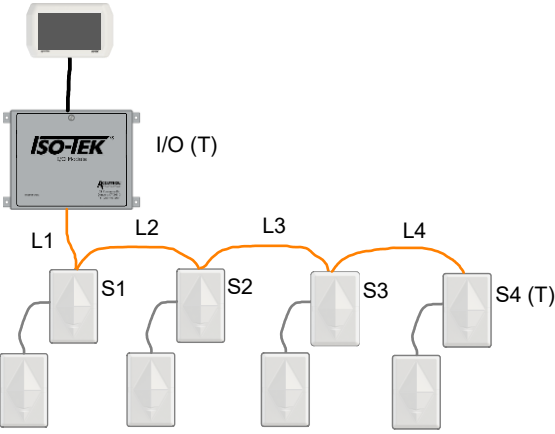


Max Cable Length:
L1 + L2 + L3 + L4 = 90 ft MAX Total

Termination (T):
I/O: ON
S1: OFF
S2: OFF
S3: OFF
S4: ON

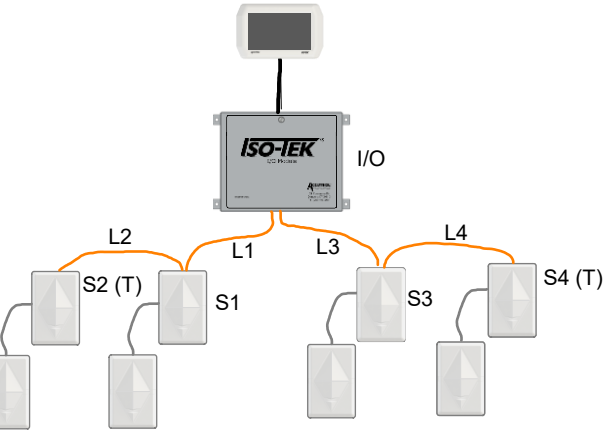

Max Cable Length:
L1 + L2 = 100 ft MAX Total
L3 + L4 = 100 ft MAX Total

Termination (T):
I/O: OFF
S1: OFF
S2: ON
S3: OFF
S4: ON

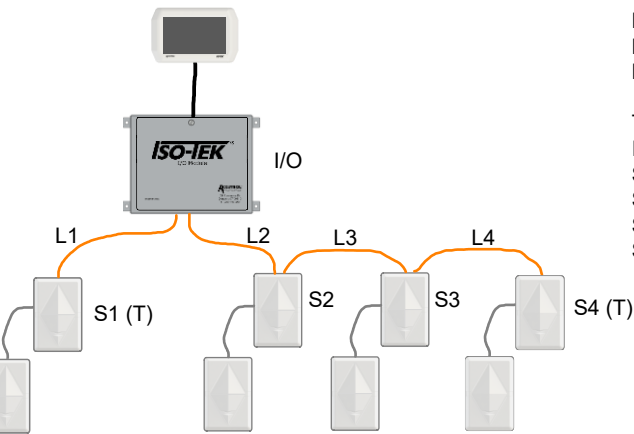

Max Cable Length:
L1 = 150 ft MAX
L2 + L3 + L4 = 100 ft MAX Total

Termination (T):
I/O: OFF
S1: ON
S2: OFF
S3: OFF
S4: ON